



NOTES

1. CONTRACTOR SHALL PROVIDE ALL CONDUITS, WIRING, AND TERMINATIONS FROM FAA PROVIDED TELEPHONE LINES IN THE EQUIPMENT ROOM TO THE FACP. SEE SPECIFICATIONS FOR DETAILS.
2. CONTRACTOR TO PROVIDE LAMINATED INSTRUCTIONS AND SEQUENCE OF OPERATION FOR THE FIRE ALARM SYSTEM AND STAIR PRESSURIZATION FAN ON 8-1/2"x11" SHEETS. LOCATE INSIDE FACP.

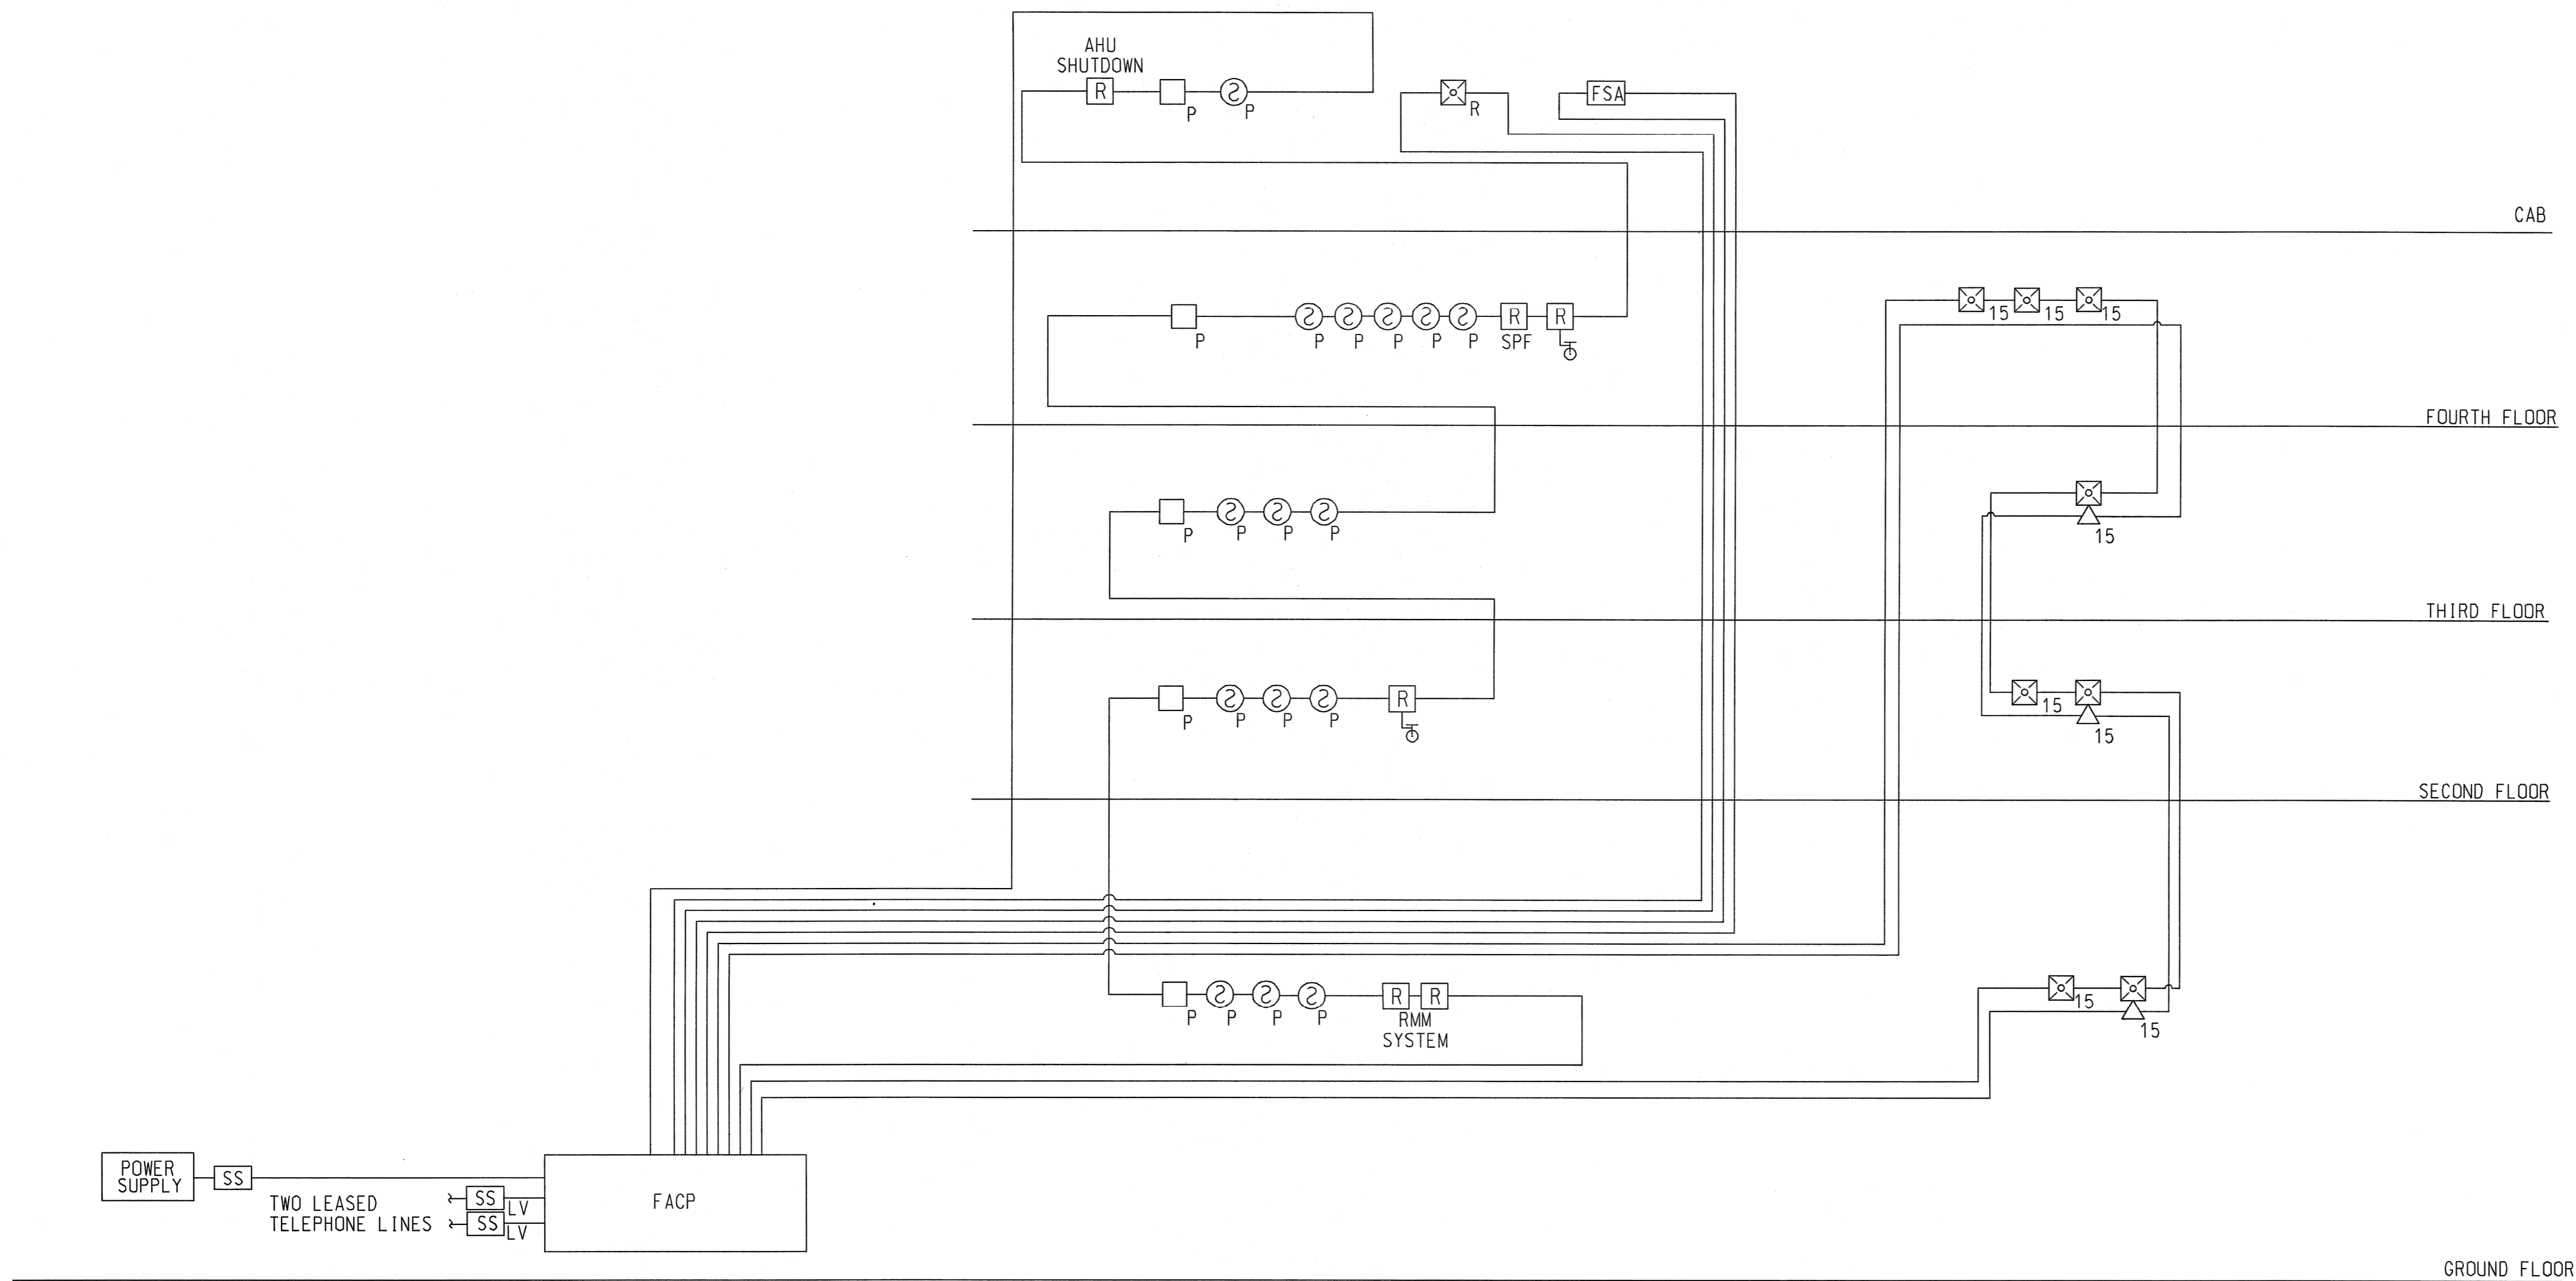

1 RISER DIAGRAM - FIRE ALARM SYSTEM
F06 NOT TO SCALE

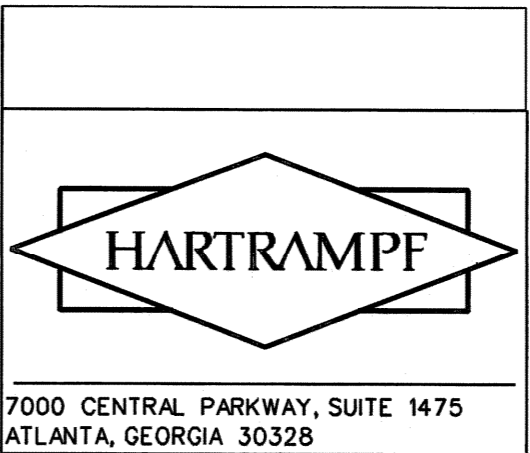

REV.	LTR.	DATE	DESCRIPTION	CHECKED	APPROVED
DEPARTMENT OF TRANSPORTATION FEDERAL AVIATION ADMINISTRATION SOUTHERN REGION ATLANTA, GEORGIA 30320					
AIRPORT TRAFFIC CONTROL TOWER (ATCT) FIRE AND LIFE SAFETY MODIFICATIONS RISER DIAGRAM FIRE ALARM SYSTEM					
JACKSON		HAWKINS FIELD		MS	
REVIEWED BY	SUBMITTED BY	APPROVED BY			
DESIGNED BY	MAS	ISSUED BY	ATLANTA NAS	DATE	12-18-2006
DRAWN BY	HJM	CHECKED BY	DWF	DRAWING NO.	SO-D-103765-F06
			IMPLEMENTATION CENTER	REV. LTR.	